


LEGEND

WATER AGE (HOUR)
 0.0 - 20.0
 20.0 - 50.0
 50.0 - 120.0
 >120.0

-  EXISTING ELEVATED TANK
-  PROPOSED ELEVATED TANK
-  EXISTING GROUND STORAGE TANK
-  EXISTING STANDPIPE

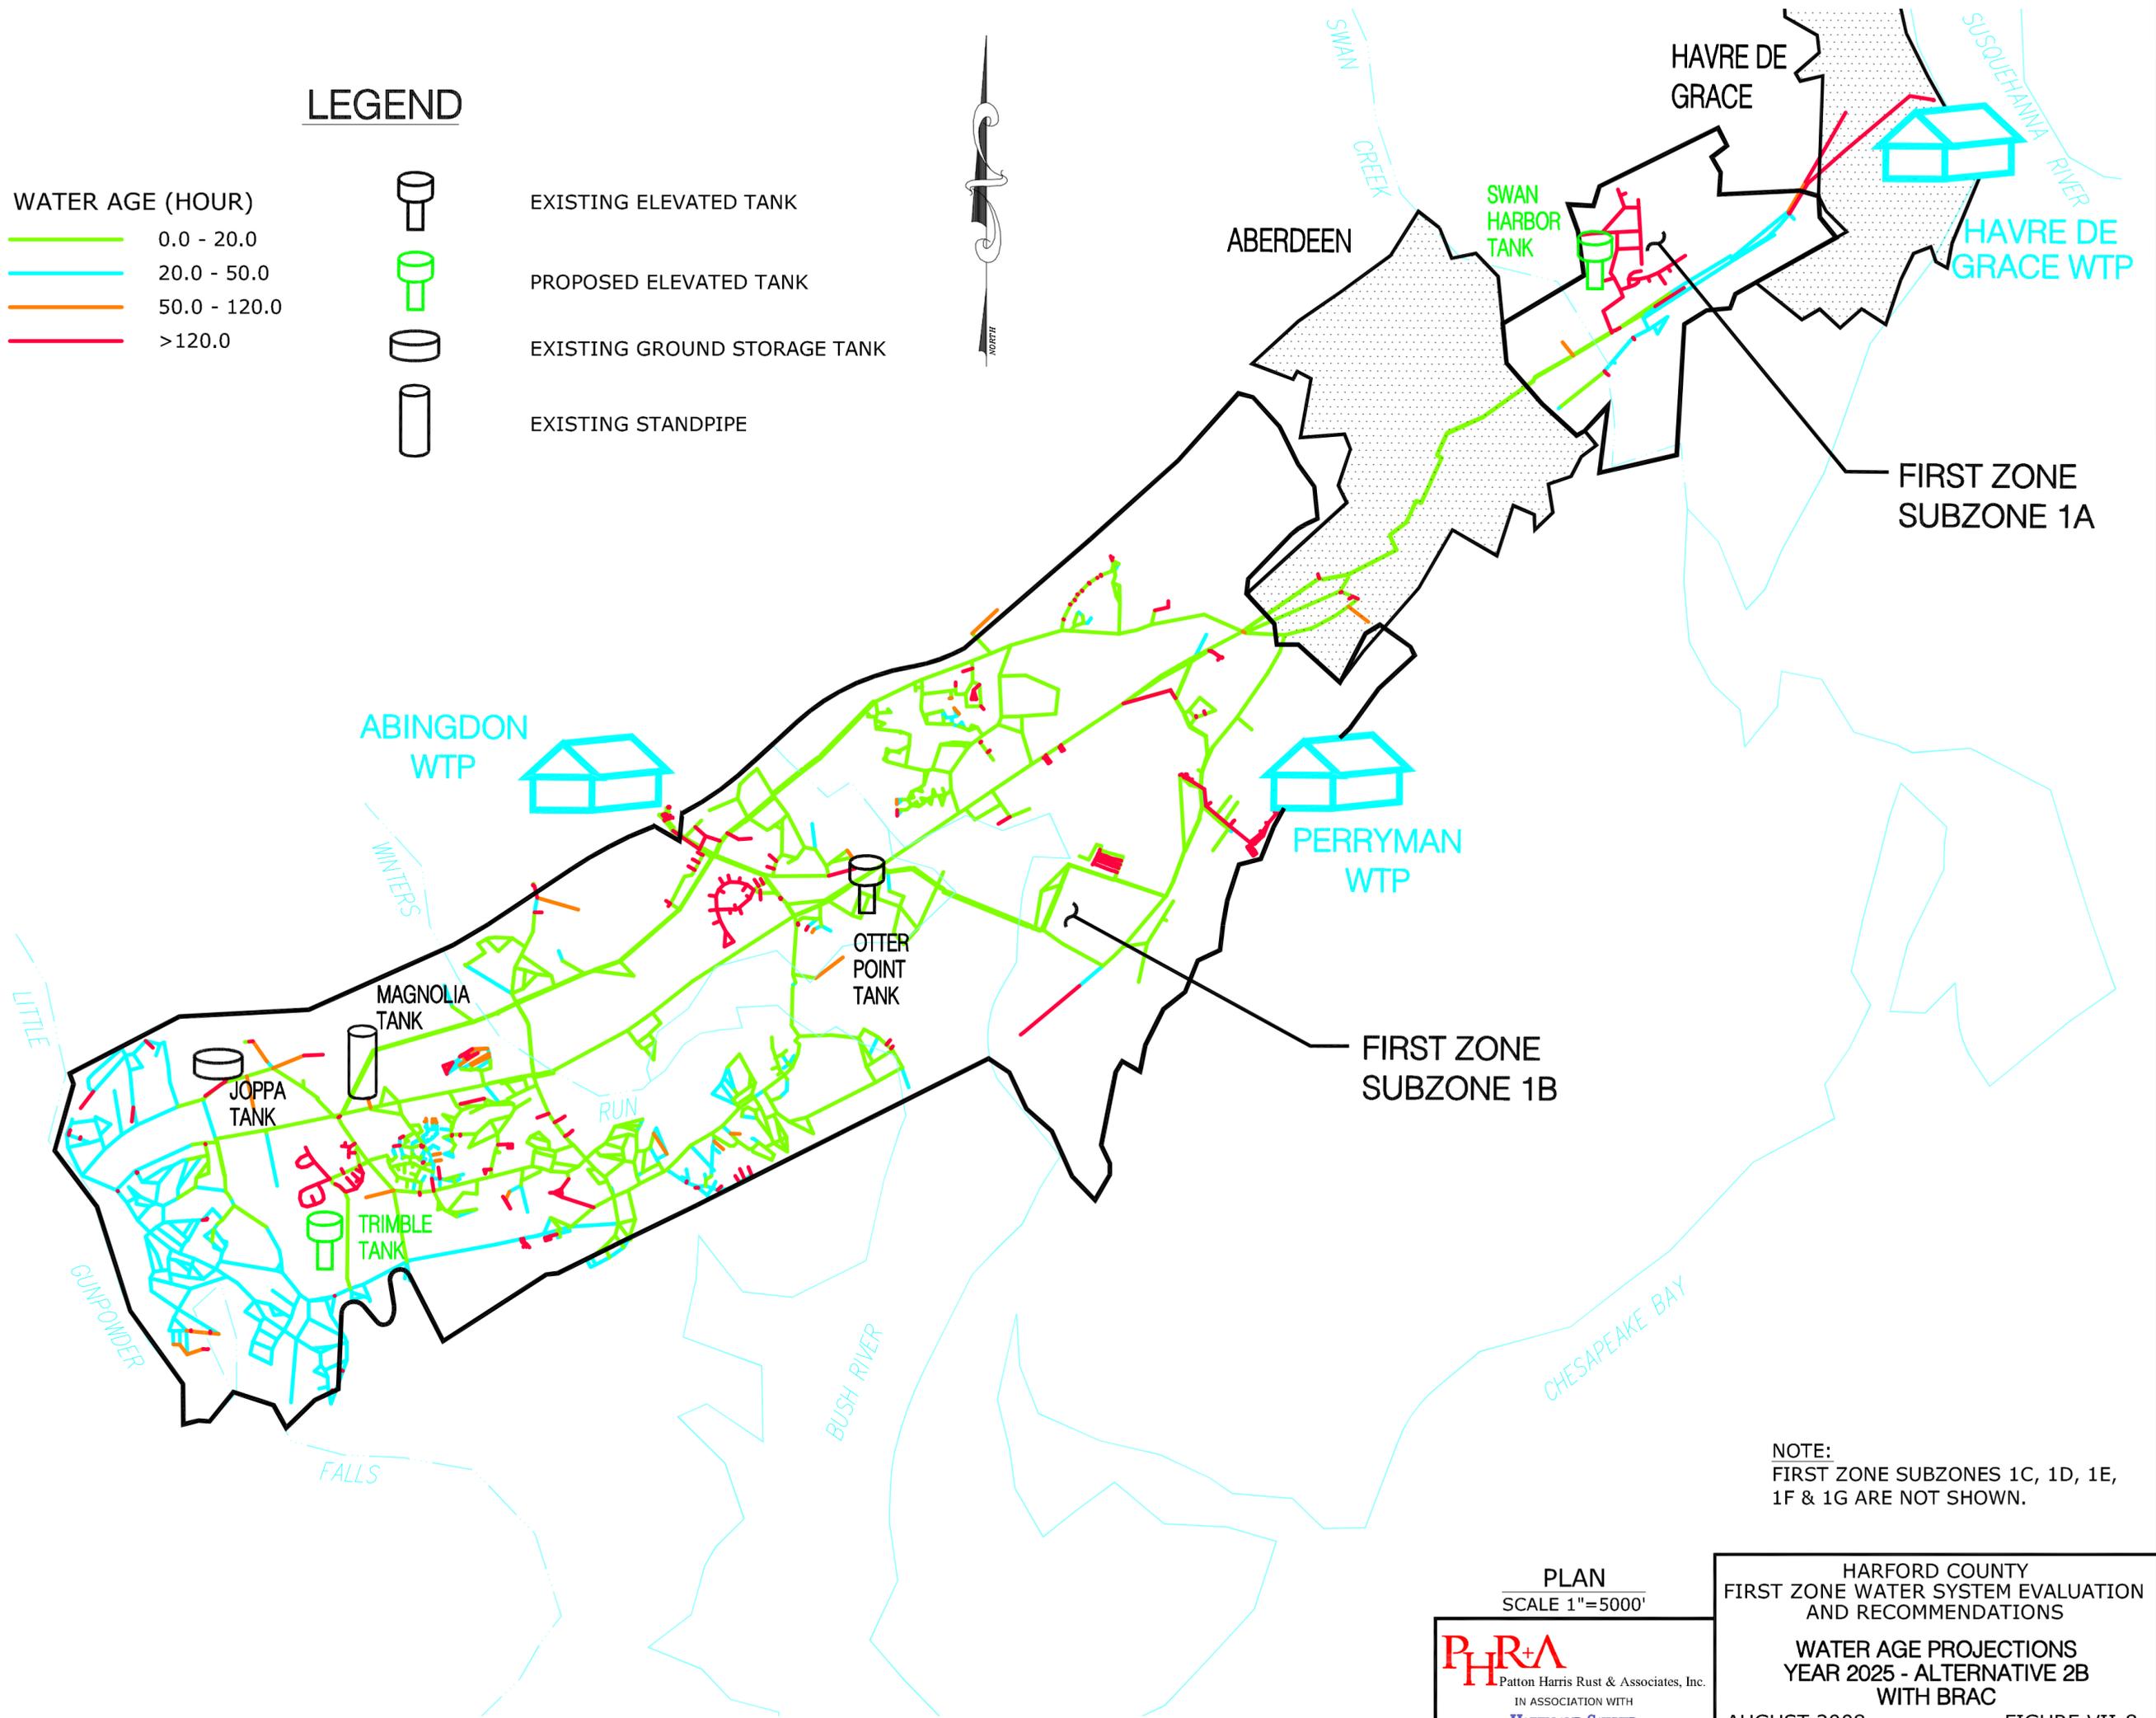

NOTE:
 FIRST ZONE SUBZONES 1C, 1D, 1E,
 1F & 1G ARE NOT SHOWN.

PLAN
 SCALE 1"=5000'



HARFORD COUNTY
 FIRST ZONE WATER SYSTEM EVALUATION
 AND RECOMMENDATIONS
 WATER AGE PROJECTIONS
 YEAR 2025 - ALTERNATIVE 2B
 WITH BRAC
 AUGUST 2008 FIGURE VII-8