


LEGEND

- DESIGNATED FIRE FLOW LOCATION
- EXISTING GROUND STORAGE TANK
- EXISTING ELEVATED TANK
- PROPOSED ELEVATED TANK
- EXISTING STANDPIPE

NOTES:

1. ALL FIRE FLOW DURATIONS ARE 2 HOURS.
2. UNLESS OTHERWISE INDICATED, ALL FIRE FLOWS ARE 1500 GPM.

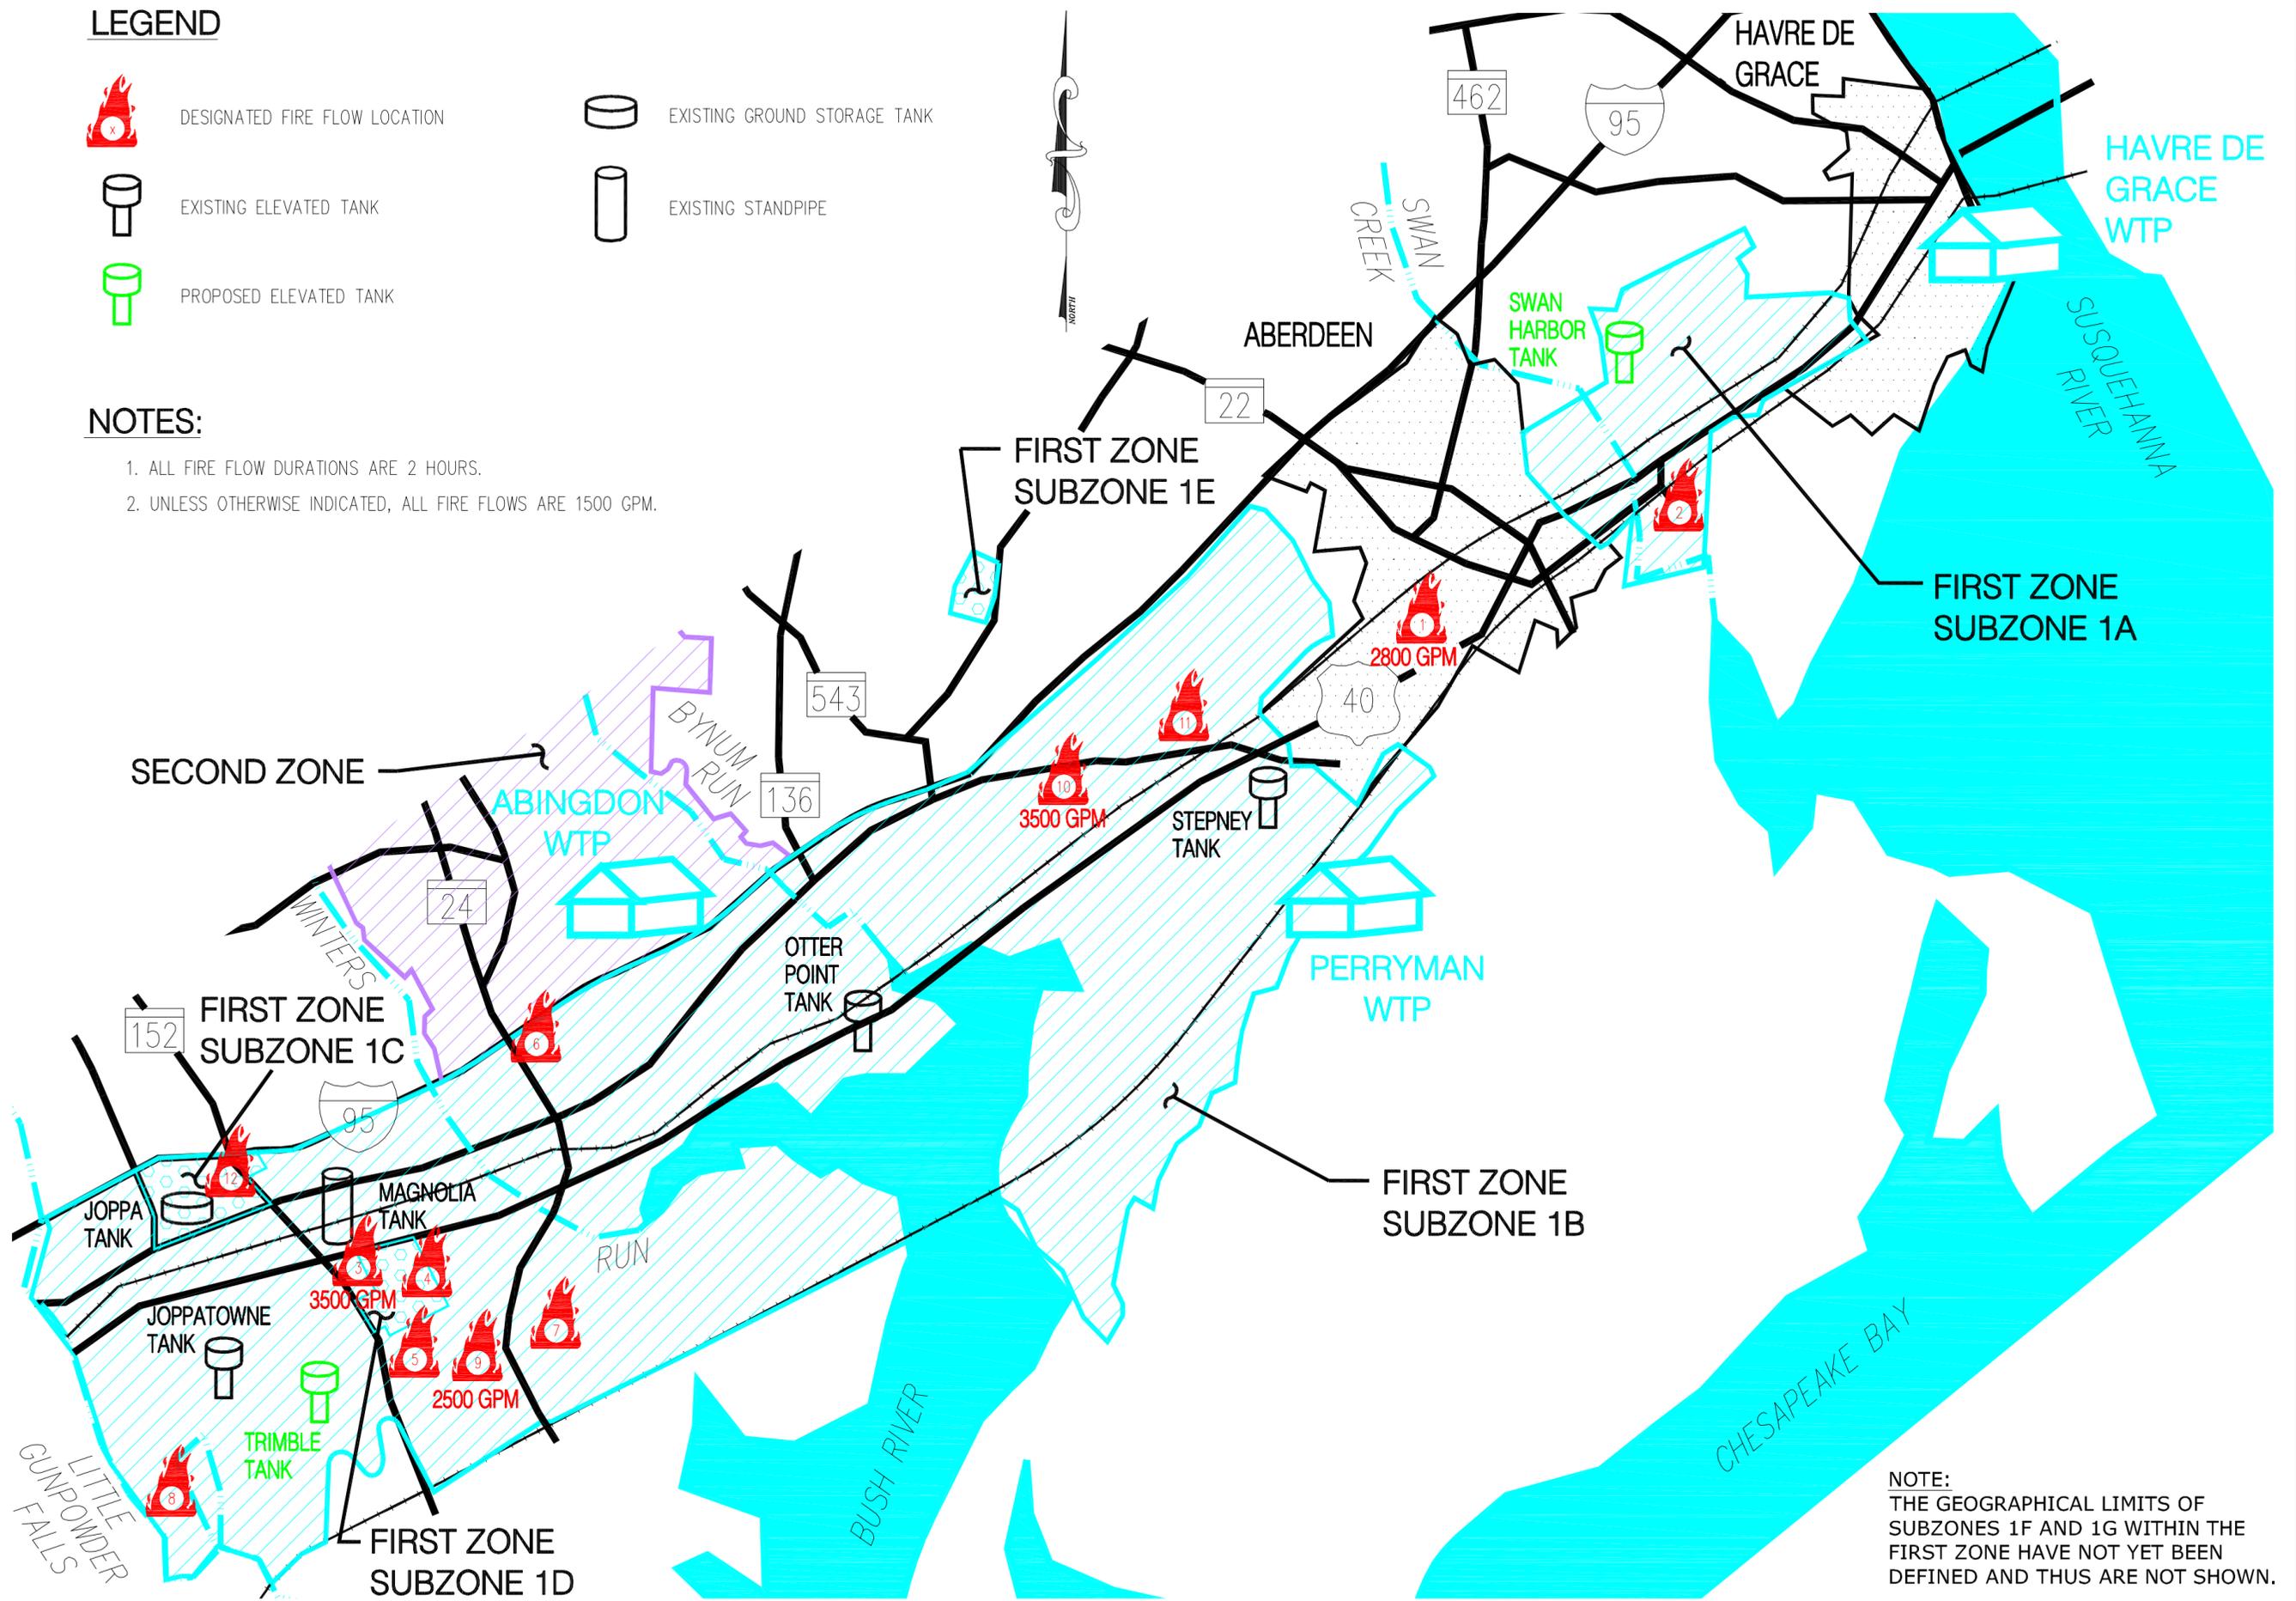

NOTE:
THE GEOGRAPHICAL LIMITS OF
SUBZONES 1F AND 1G WITHIN THE
FIRST ZONE HAVE NOT YET BEEN
DEFINED AND THUS ARE NOT SHOWN.

PLAN
SCALE 1"=5000'



HARFORD COUNTY
FIRST ZONE WATER SYSTEM EVALUATION
AND RECOMMENDATIONS

FIRE FLOW
LOCATION PLAN

AUGUST 2008

FIGURE IV-1